

600 A 35 kV class BOL-T™ deadbreak connector



General

Eaton's Cooper Power Systems 600 A, 35 kV Class BOL-T™ deadbreak connector is used to terminate high-voltage underground cables to deadfront apparatus such as transformers, switches and switchgear. It is fully shielded, submersible, and meets the requirements of IEEE Std 386™-2006 standard— Separable Insulated Connector Systems.

The capacitive test point on the insulating plug provides a means of testing the circuit without disturbing the bolted connection.

In addition to the capacitive test point feature on the insulating plug, Eaton's Cooper Power Systems offers an optional capacitive test point similar to the test points on Eaton's Cooper Power Systems 200 A elbows. This allows the use of the Type "TPR" Series Fault Indicators, and provides

a hotstick operable means of determining circuit condition when used with high impedance voltage sensing devices designed for test points.

BOL-T connectors are designed for use on solid dielectric cable (XLPE or EPR) with extruded semiconductive shields and concentric neutral, with or without a jacket.

Installation on jacketed concentric neutral cable may require additional sealing material. A special grounding adapter is available for tape shield, linear corrugated, unshield, and drain wire cables for use with deadbreak connectors.

900 Amp rating

The BOL-T connector is rated for 900 A continuous when used with a coppertop compression connector, copper insulating plug, copper stud and copper bushing or junction. If a 900 A rating is desired, specify a "C" as the 9th digit when determining your part number. See Step 3, page 4.

200 kV BIL rating

The BOL-T connector is available with an optional 200 kV BIL rating, allowing you to match the BIL rating of the system and the equipment to which it will be connected. If 200 kV BIL rating is required, specify "38" in digits 4 and 5 in the part number. See page 4.

Interchangeability

All Eaton's Cooper Power Systems 600 A deadbreak connectors conform to the electrical, mechanical and dimensional requirements of IEEE Std 386™-2006 standard. The connectors can be used on any comparably rated bushing interface that also meets the requirements of this standard. In addition, all cable adapters, insulating plugs and compression connectors are designed to be interchangeable with those currently available from other major manufacturers that also certify their components to IEEE Std 386™-2006 standard.

Installation

A torque wrench and one-inch socket are used to tighten the insulating plug through the compression or shear bolt connector within the T-Body onto a de-energized 600 A bushing interface. Refer to Installation Instruction Sheet S600-50-2 for details.

Production tests

Tests are conducted in accordance with IEEE Std 386™-2006 standard.

- ac 60 Hz 1 Minute Withstand
 - 50 kV/70 kV
- Minimum Partial Discharge Extinction Voltage
 - 26 kV

Tests are conducted in accordance with Cooper Power Systems requirements.

- Physical Inspection
- Periodic Dissection
- Periodic X-ray Analysis

Table 1. Voltage Ratings and Characteristics

Description	kV
Standard Voltage Class	35
Maximum Rating Phase-to-Ground	21.1
AC 60 Hz 1 Minute Withstand	
150 kV BIL Class BOL-T	50
200 kV BIL Class BOL-T	70
DC 15 Minute Withstand	103
BIL and Full Wave Crest	150/200
Minimum Partial Discharge Extinction Voltage	26

Voltage ratings and characteristics meet or exceed IEEE Std 386™-2006 standard.

Table 2. Current Ratings and Characteristics

Description	Amperes	
Continuous	600 A rms (Aluminum)	900 A rms (Copper)
4 Hour Overload	900 A rms (Aluminum)	1,200 A rms (Copper)
Short Time	25,000 A rms symmetrical for 0.20 s	
	10,000 A rms symmetrical for 4.0 s	

Current ratings and characteristics meet or exceed IEEE Std 386™-2006 standard.

Optional features

Coppertop compression connectors

Coppertop compression connectors (aluminum sleeve welded to a copper spade) provide a high conductivity material in a bolted connection and are compatible with aluminum or copper conductors.

Shear bolt connectors

Bolted cable lug is fitted with stepless bolts, which shear off when optimum contact force has been reached. Provides electrical continuity for copper and aluminum conductors while eliminating need for dies and compression tools.

Current path

Full copper current carrying path can be obtained by specifying a coppertop compression connector, copper stud and copper insulating plug.

Ordering information

Each BOL-T Connector kit contains:

- Molded Rubber T-Body
- Insulating Plug
- Cap
- Compression or Shear Bolt Connector
- Cable Adapter
- Silicone Lubricant
- Installation Instruction Sheet

To order a 35 kV Class BOL-T Connector kit, see Steps 1-5 to build the catalog number.

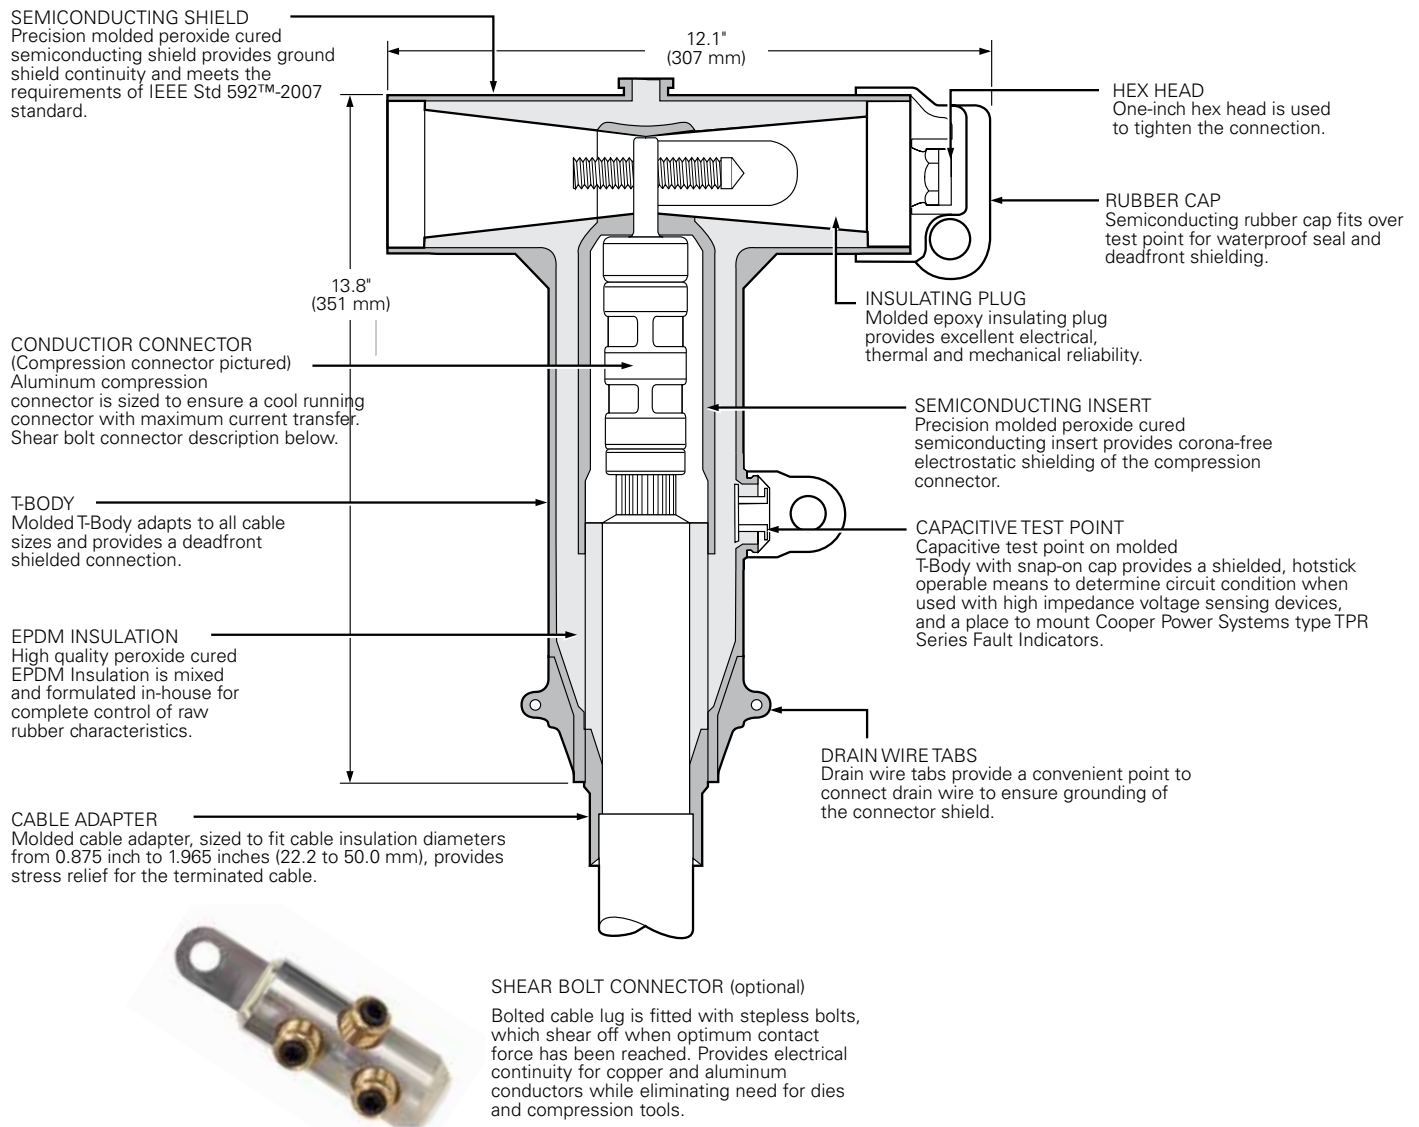


Figure 1. BOL-T cutaway illustrates design features.

Note: Dimensions given are for reference only.

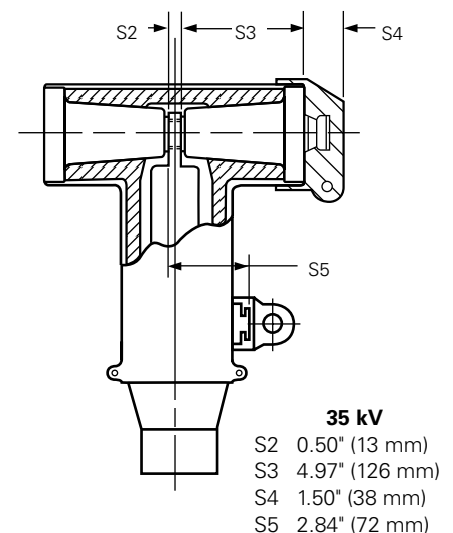


Figure 2. BOL-T Stacking Dimensions.

BOLT Connector Kit – Catalog Numbering System

Build the 11 digit catalog number for a BOLT kit by following the steps given below. The first 3 digits are "BT6", so only digits 4 through 11 need to be selected.

1	2	3	4	5	6	7	8	9	10	11
B	T	6								

Catalog Number Digits:

1 & 2 = "BT", BOLT Connector System

3 = "6", 600 A System

Step 1 – Select BIL Rating Requirement

4 & 5 = "35", 35 kV Class Bushing Interface, 150 kV BIL

"38", 35 kV Class Bushing Interface, 200 kV BIL

Step 2 – Select Digit 6 Cable Adapter Range Code

Determine the cable's diameter over the electrical insulation as shown in Figure 3 (including tolerances).

Then identify a cable range from Table 3 that covers the minimum and maximum insulation diameters.

Select the correct CABLE RANGE CODE from Table 3.

Step 3 – Select Digits 7 and 8 Conductor Code

Identify the conductor size and type in Table 4 and select the CONDUCTOR CODE from the appropriate (compression or shear bolt) column.

Step 4 – Select Digit 9

Determine whether Aluminum or Copper is required for the compression connector, stud, and deadbreak insulating plug. The shear bolt connector is only available as a 600 A aluminum connector.

"A" = Aluminum (compression or shear bolt)

"C" = Copper (coppertop for the connector) Required to achieve 900 A rating (compression connector only).

Step 5 – Select Digit 10

Determine if a stud should be included in the kit. The stud will be fixed inside the deadbreak insulating plug.

"1" = Stud Included

"2" = Stud Not Included

Step 6 – Select Digit 11

Determine if the T-Body should have a test point.

"T" = Test Point on T-Body

If no test point is required, do not include an 11th digit.

Table 3. Cable Diameter Range

Inches	mm	Cable Range Code	Inches	mm	Cable Range Code
0.875-0.985	22.2-25.0	D	1.355-1.520	34.4-38.6	M
0.930-1.040	23.6-26.4	E	1.485-1.595	37.7-40.5	N
0.980-1.115	24.9-28.3	F	1.530-1.640	38.9-41.7	P
1.040-1.175	26.4-29.8	G	1.575-1.685	40.0-42.8	Q
1.095-1.240	27.8-31.5	H	1.665-1.785	42.3-45.3	R
1.160-1.305	29.5-33.1	J	1.755-1.875	44.6-47.9	S
1.220-1.375	31.0-34.9	K	1.845-1.965	46.9-50.0	T
1.285-1.395	32.5-35.4	L	1.960-2.210	49.8-56.1	U

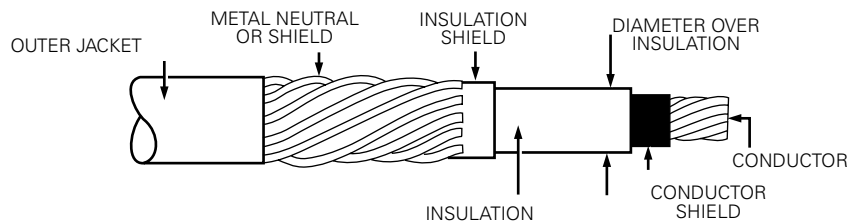


Figure 3. Illustration showing typical construction of medium voltage underground cable.

Table 4. Conductor Size and Type

Compression Connector					Shear Bolt Connector						
Concentric or Compressed		Compact or Solid		Compression Conductor Code	AWG or Kcmil			mm ² Stranded & Compressed		Shear Bolt Conductor Code	Shear Bolt Catalog Number
AWG or kcmil	mm ²	AWG or kcmil	mm ²		Concentric	Compressed	Compact	min	max		
No Connector				0	3/0	3/0	3/0				
#2	35	1	-	11	4/0	4/0	4/0	95	150	S1	CDT630SB150
#1	-	1/0	50	12	250	250	250				
1/0	50	2/0	70	13	-	-	350				
2/0	70	3/0	-	14	350	350	-	185	300	S3	CDT630SB300
3/0	-	4/0	95	15	500	500	500				
4/0	95	250	120	16	600	600	600				
250	120	300	-	17	-	-	700	400		S4	CDT630SB400
300	-	350	-	18	700	700	-				
350	-	400	185	19	750	750	750				
400	185	450	-	20	-	800	800	500	630	S6	CDT1250SB630
450	-	500	240	21	-	-	900				
500	240	600	300	22	800	-	-				
600	300	700	-	23	900	900	-	800		S8	CDT1250SB800
650	-	750	-	24	1000	1000	1000				
750	-	900	-	25	1100	1100	-				
900	-	1000	500	26	1200	1200	-	800		S8	CDT1250SB800
1000	500	-	-	27	1250	1250	-				
1250	630	-	-	28	1300	1300	-				
-	-	-	-	-	1400	1400	-	800		S8	CDT1250SB800
-	-	-	-	-	1500	1500	-				

EXAMPLE: Select a 200 kV BIL BOL-T kit for 250 kcmil compressed cable with a nominal insulation diameter of 1.16". The kit should have aluminum current-carrying parts and should have a stud included. The T-Body should have a test point.

Step 1 – Select Digits 4 and 5

This kit requires a 200 kV BIL interface.

Select "38" for digits 4 and 5.

Step 2 – Select Digit 6

Nominal diameter over insulation is $1.16" \pm .030"$.

Minimum diameter = $1.16" - .030" = 1.13"$.

Maximum diameter = $1.16" + .030" = 1.19"$.

From Table 3, identify the cable range that covers 1.13" - 1.19" and select the "H" cable range code.

Step 3 – Select Digits 7 and 8

The conductor size is 250 kcmil compressed. From Table 4, under the column "Concentric or Compressed," identify 250 kcmil and select the "17" conductor code.

Step 4 – Select Digit 9

This kit requires aluminum current-carrying parts. Select an "A" for digit 9.

Step 5 – Select Digit 10

This kit requires a stud, so select "1" for digit 10.

Step 6 – Select Digit 11

A test point is needed, so use a "T" for digit 11.

The complete catalog number is:

BT638H17A1T

Accessories

Cable adapters, compression connectors, and other accessories that can be used with Cooper Power Systems BOL-T Connectors are described in Catalog Section 600-66, "Deadbreak Accessories, Tools, and Replacement Parts."

Table 5. Replacement Parts

Description	Catalog Number	
	150 kV BIL	200 kV BIL
T-Body without Test Point	DT635	DT638
T-Body with Test Point	DT635T	DT638T
Cap for Insulating Plug	DIPCAP	DIPCAP
Aluminum Insulating Plug with Cap (No Stud)	DIP635A	DIP638A
Aluminum Insulating Plug with Cap and Aluminum Stud*	DIP635AS	DIP638AS
Copper Insulating Plug with Cap (No Stud)	DIP635C	DIP638C
Copper Insulating Plug with Cap and Copper Stud*	DIP635CS	DIP638CS
5/8" – 11 UNC 2A Aluminum Threaded Stud	STUD635-A	STUD635-A
5/8" – 11 UNC 2A Copper Threaded Stud	STUD635-C	STUD635-C

* STUD comes loose in kit, add "P" to part number for factory installation.

This page is intentionally left blank.

Eaton
1000 Eaton Boulevard
Cleveland, OH 44122
United States
Eaton.com

Eaton's Cooper Power Systems Business
2300 Badger Drive
Waukesha, WI 53188
United States
Cooperpower.com

© 2014 Eaton
All Rights Reserved
Printed in USA
Publication No. TD650025EN

Eaton, Cooper Power Systems, and BOL-T are valuable trademarks of Eaton in the U.S. and other countries. You are not permitted to use these trademarks without the prior written consent of Eaton.
IEEE Std 386™-2006 and IEEE Std 592™-2007 standards are trademarks of the Institute of Electrical and Electronics Engineers, Inc., (IEEE). This publication is not endorsed or approved by the IEEE.

For Eaton's Cooper Power Systems BOL-T connector product information call 1-877-277-4636 or visit: www.cooperpower.com.